

Notes:
For General notes see GN1

LOAD CONSIDERATION:
Imposed load not to exceed 1 No working level rated at 1.5 kN/m² and 1No. level at 0.75 kN/m² between uprights with 0.75 kN/m² on the inside boards.

Max. Tie Load:
Compression: 5.93 kN
Tension: 3.51 kN

Transoms to be underslung off 2 No. ledgers using load bearing fittings at all the positions.

SHORING WORK

We cannot and will not pass comment on the structure being shored, as this involves matters beyond our control and knowledge. It is the contractors responsibility to ensure that the existing structure will safely span between our supports, and can be safely shored in the way indicated.

FOUNDATIONS

The contractor must prepare all foundations prior to erection.

TEMPORARY ROOFS

No temporary roof can be made watertight .
Loading : Snow loading assessed usin BS6399 Part , unless the contractor adopts a snow management system

MATERIALS

All scaffolding materials forming this structure are to comply, and to be constructed in accordance with BS 1139 and TG20 :13 (Current editions)

MODIFICATION


No alteration is to be made to the structure detailed on this drawing without prior written permission.

DIMENSIONS

Written dimensions shall take precedence over scaled dimensions. The contractor must verify all site dimensions and notify of any discrepancy prior to erection .

PERMITS AND PERMISSIONS

The contractor must obtain all permits and permissions prior to erection.

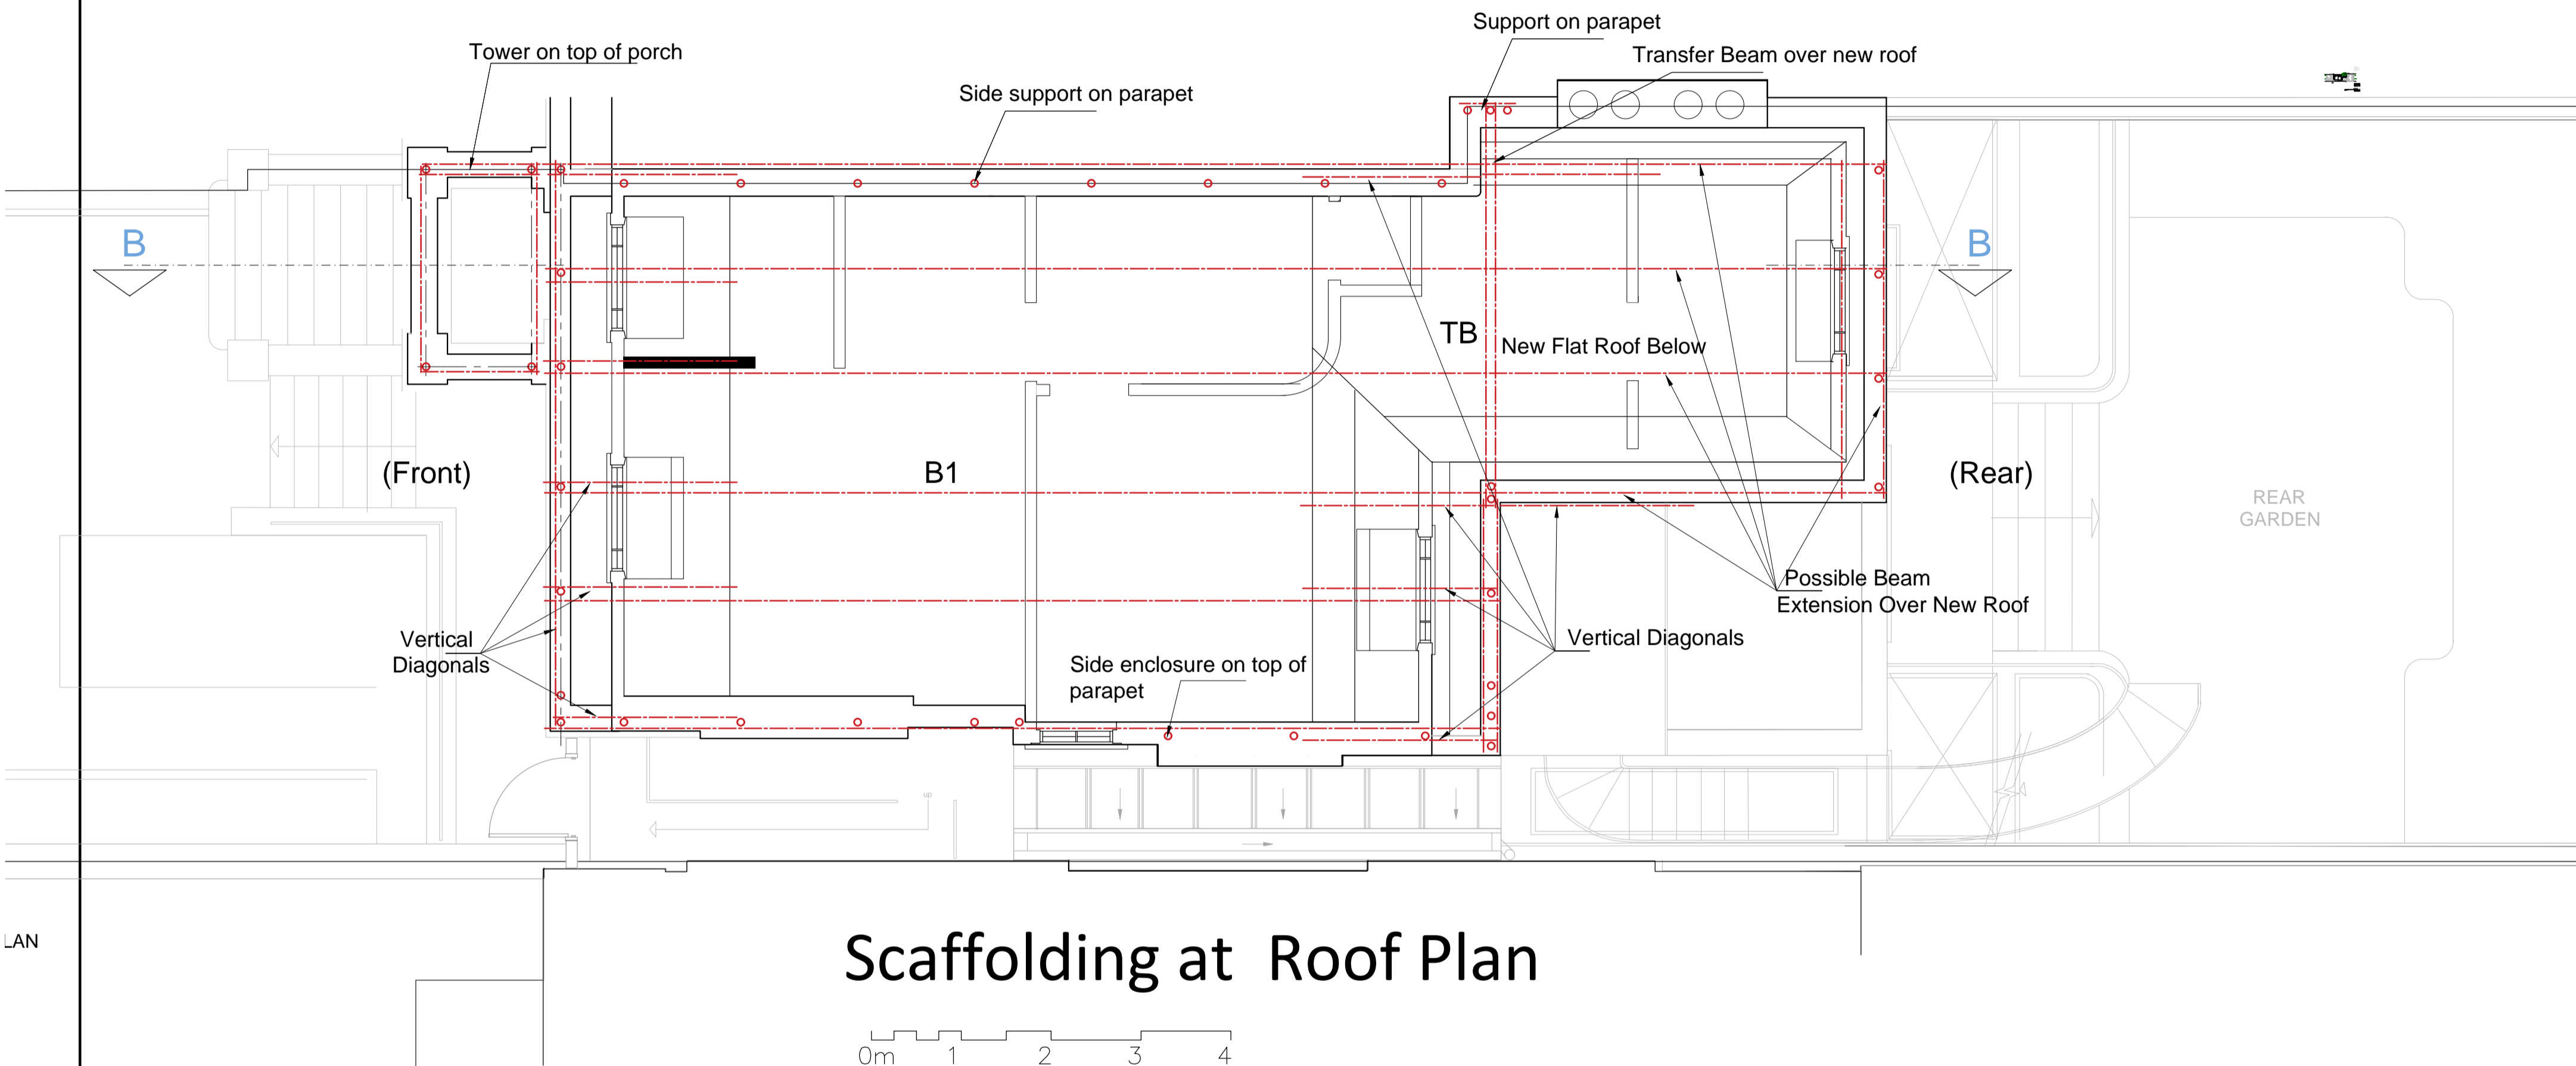

Scaffolding at Roof Plan

0m 1 2 3 4

Transoms to be underslung off 2 No. ledgers using load bearing fittings at all the positions.

Scaffold to be tied to existing structure every alternate frame longitudinally and every indicated lift below top tie level.

Max. Tie Load:
Compression: 5.93 kN
Tension: 3.51 kN

ALL COUPLERS TO BE TYPE EN 74 CLASS A COUPLER WITH MIN 6.1 SLIP CAPACITY

GENERAL NOTES :
BASIS OF DESIGN


This drawing has been prepared from information supplied to us by, or on behalf of the contractor, who should check that his requirements have been correctly interpreted and that all loadings, dimensions, lift heights, bay sizes, erection/strlking sequences etc. are as required and practicable.

IMPOSED LOADS

The contractor is to ensure that the existing structure. It's fabric and/ or the ground will safely support the extra imposed loads; or supply new.
Maximum calculated tie load;
Maximum calculated leg load;

CONSTRUCTION NOTES:

- 1) Unless otherwise noted all lifts other than boarded platform levels are to be constructed using load bearing couplers
- 2) All general construction to be in accordance to TG20:13 unless noted otherwise
- 3) Main contractor to undertake all making good where necessary.
- 4) Main contractors to provide and maintain adequate tie positions
- 5) No sheeting, wind protection or fans to be added to this structure without prior written permission.

Rev	Date	Description
 LIM ENGINEERING LTD consulting engineers		
Project:- 18 Dawson Place London, W2 4TJ		
Drawing:- ROOF PLAN SCAFFOLDING PLAN		
Scale	Drawn	Checked
1:50 @ A1		
Date		
Aug. 2016		
Job No	1043	Drng No
		SF01
Rev		

Notes:
For General notes see GN1

Max. Tie Load:
Compression: 5.93 kN
Tension: 3.51 kN


ALL COUPLERS TO BE TYPE
EN 74 CLASS A COUPLER
WITH MIN 6.1 SLIP CAPACITY

LOAD CONSIDERATION:
Imposed load not to exceed 1 No working level rated at 1.5 kN/m² and 1No. level at 0.75 kN/m' between uprights with 0.75 kN/m² on the inside boards.

Transoms to be underslung off 2 No. ledgers using load bearing fittings at all the positions.

Scaffold to be tied to existing structure every alternate frame longitudinally and every indicated lift below top tie level.

Scaffolding Section B-B



SHORING WORK

We cannot and will not pass comment on the structure being shored, as this involves matters beyond our control and knowledge. It is the contractors responsibility to ensure that the existing structure will safely span between our supports, and can be safely shored in the way indicated.

FOUNDATIONS

The contractor must prepare all foundations prior to erection.

TEMPORARY ROOFS

No temporary roof can be made watertight .
Loading : Snow loading assessed usin BS6399 Part , unless the contractor adopts a snow management system

MATERIALS

All scaffolding materials forming this structure are to comply, and to be constructed in accordance with BS 1139 annnd TG20 :13 (Current editions)

MODIFICATION


No alteration is to be made to the structure detailed on this drawing without prior written permission.

DIMENSIONS

Written dimensions shall take precedence over scaled dimensions. The contractor must verify all site dimensions and notify of any discrepancy prior to erection .

PERMITS AND PERMISSIONS

The contractor must obtain all permits and permissions prior to erection.

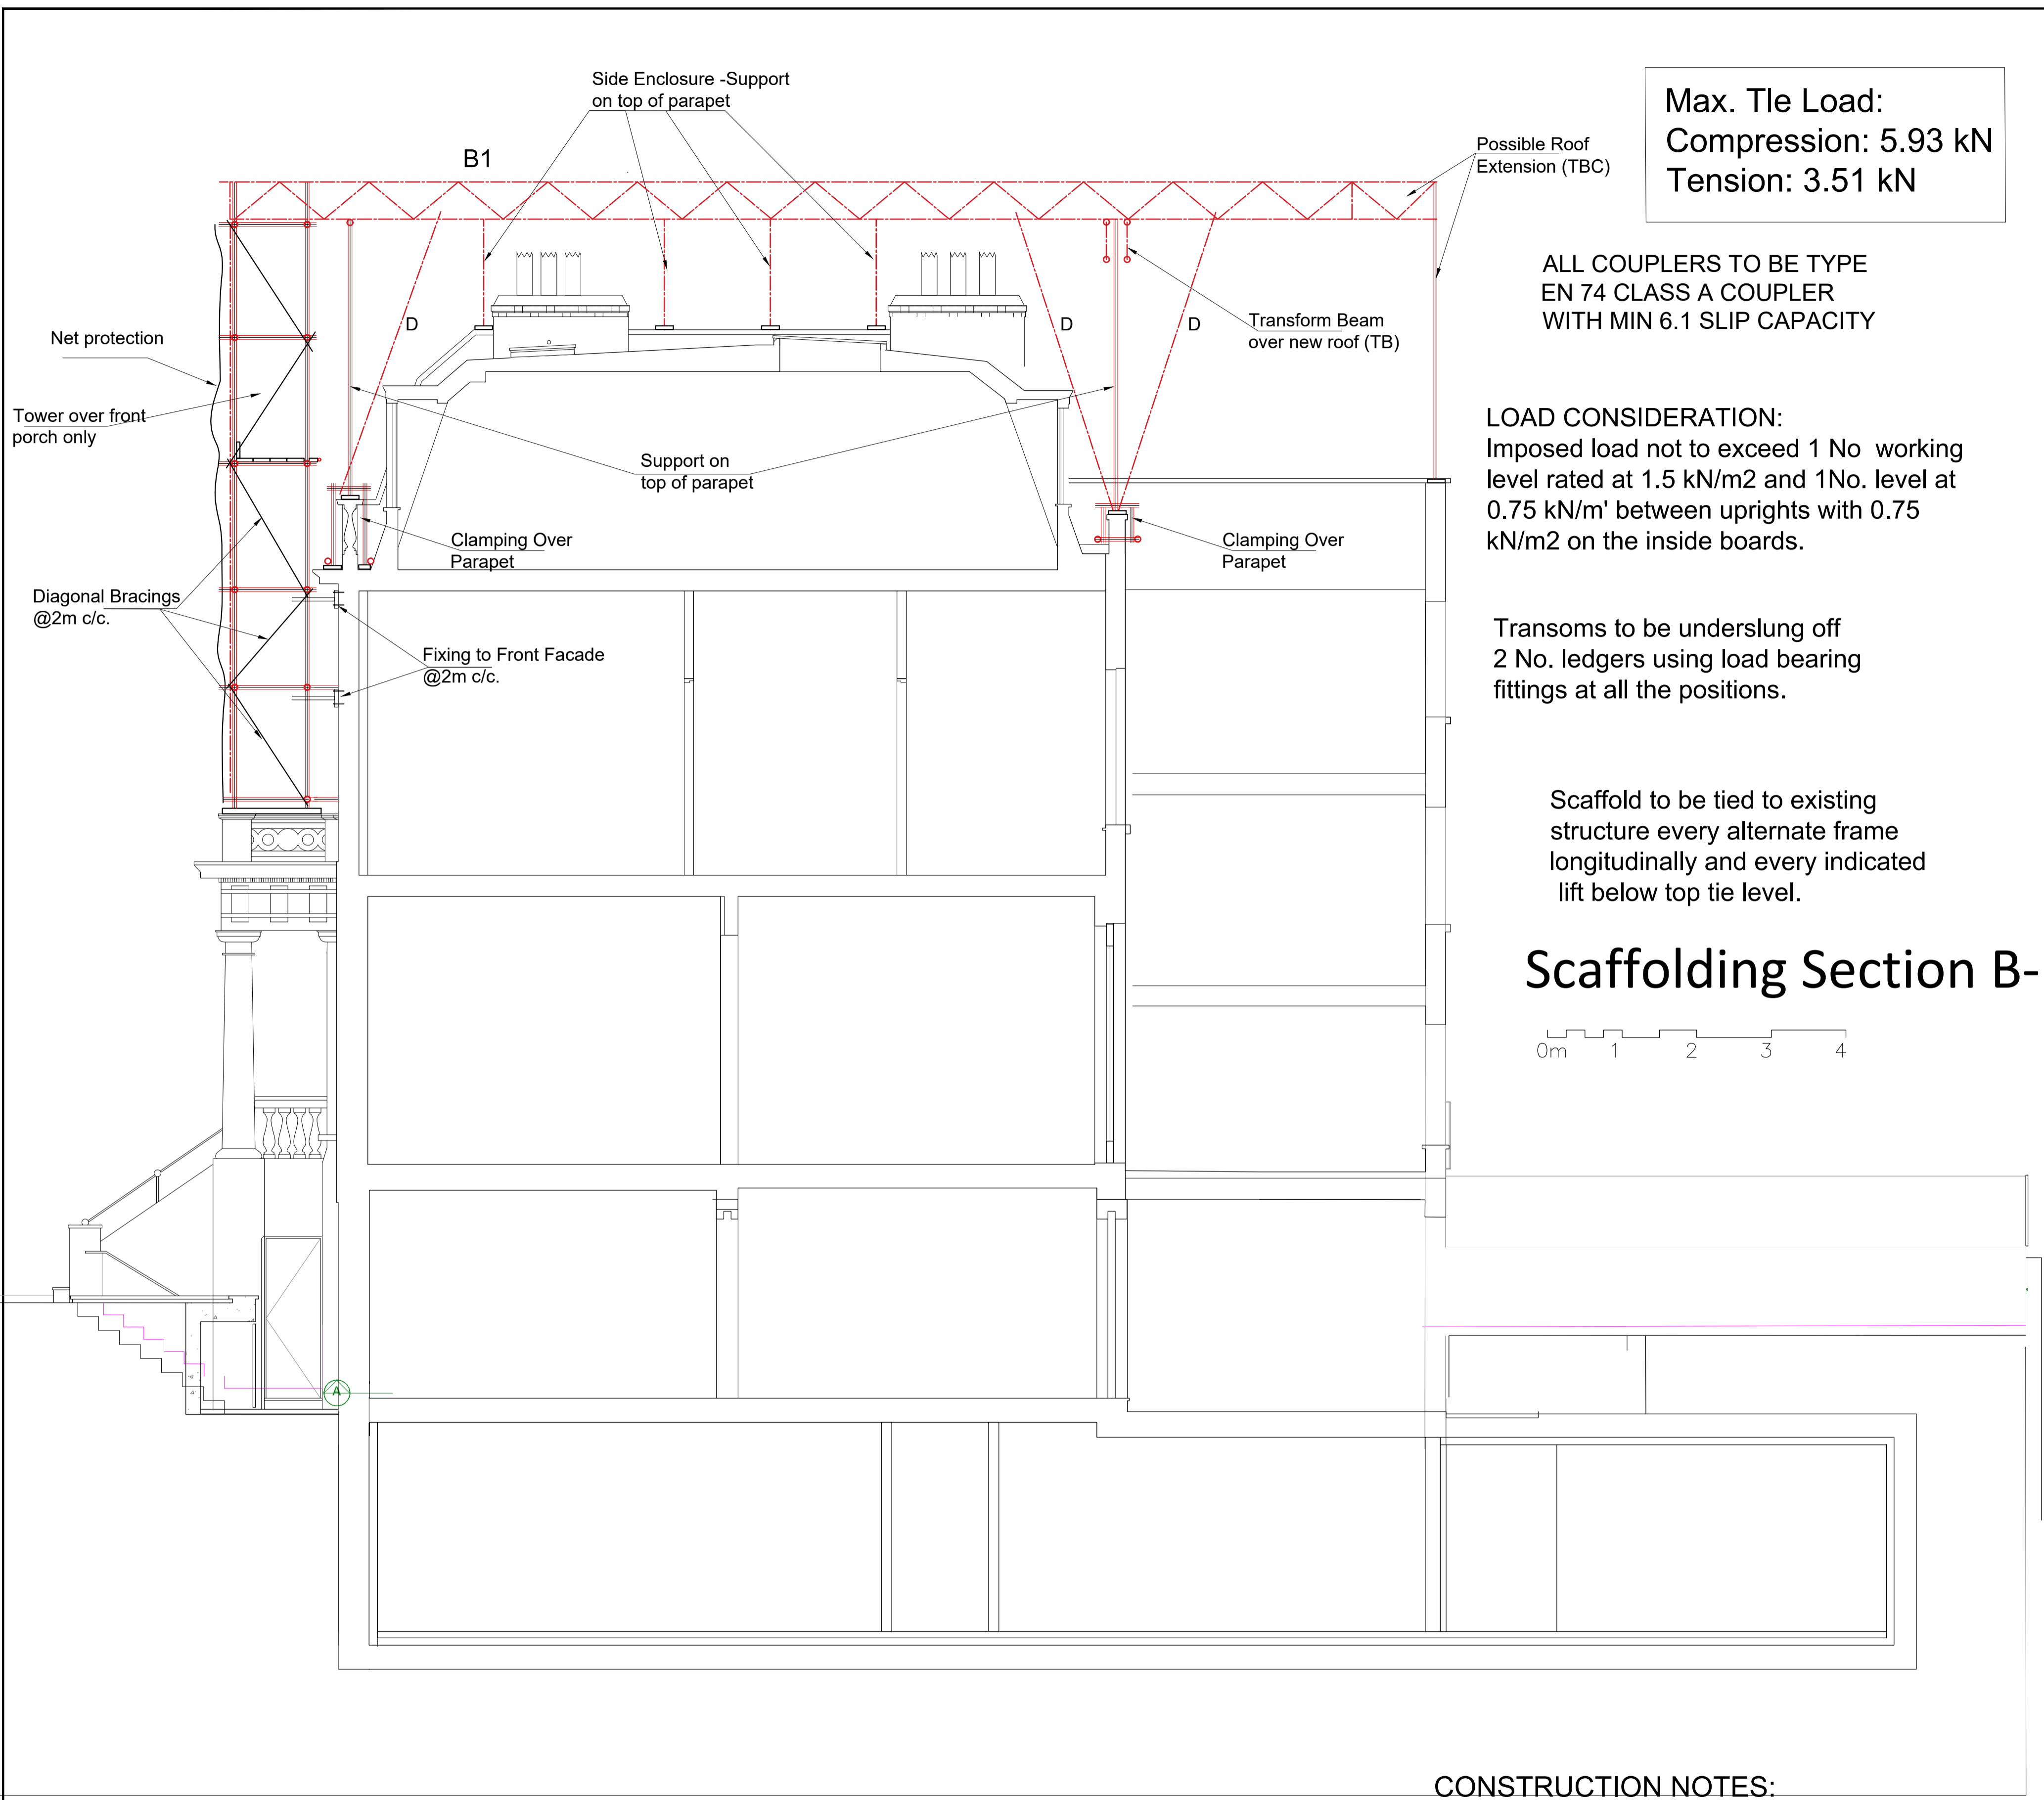

CONSTRUCTION NOTES:

- 1) Unless otherwise noted all lifts other than boarded platform levels are to be constructed using load bearing couplers
- 2) All general construction to be in accordance to TG20:13 unless noted otherwise
- 3) Main contractor to undertake all making good where necessary.
- 4) Main contractors to provide and maintain adequate tie positions
- 5) No sheeting, wind protection or fans to be added to this structure without prior written permission.


GENERAL NOTES :

BASIS OF DESIGN

This drawing has been prepared from information supplied to us by, or on behalf of the contractor, who should check that his requirements have been correctly interpreted and that all loadings, dimensions, lift heights, bay sizes, erection/strlking sequences etc. are as required and practicable.

IMPOSED LOADS

The contractor is to ensure that the existing structure. It's fabric and/ or the ground will safely support the extra imposed loads; or supply new.
Maximum calculated tie load;
Maximum calculated leg load;

Rev	Date	Description
 LIM ENGINEERING LTD consulting engineers		
Project:- 18 Dawson Place London, W2 4TJ		
Drawing:- SECTION B-B SCAFFOLDING PLAN		
Scale	Drawn	Checked
1:50 @ A1		
Date	Date	
	Aug. 2016	
Job No	1043	Rev
Drg No	SF02	